CRYO SYSTEM

FLARE HISTORICAL DATA - MOLECULAR SIEVE REGENERATION

Back to Menu

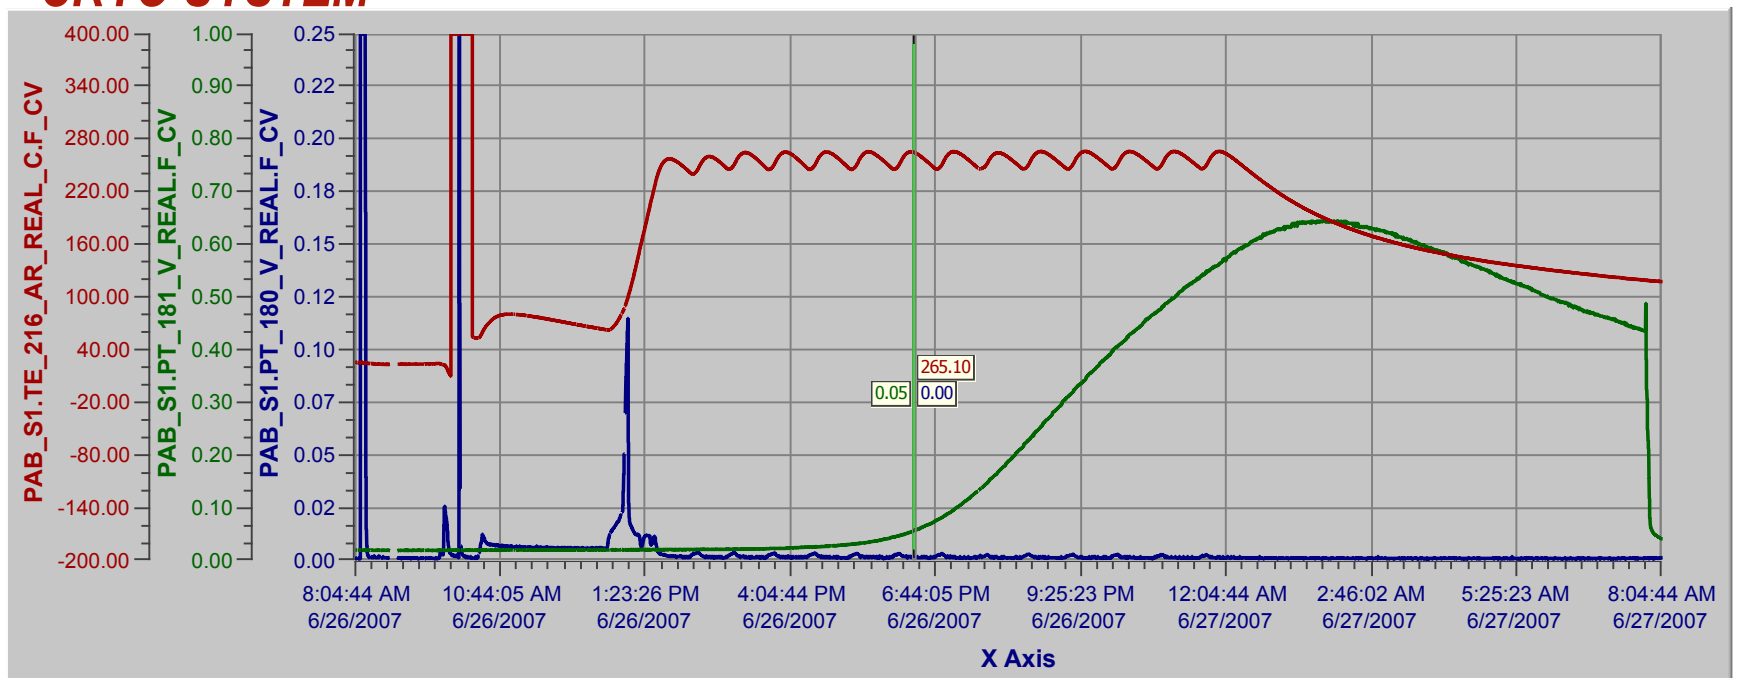

Pen Name	Description	Value	Eng Units
PAB_S1.PT_180_V_REAL.F_CV	Mole Sieve Filter Insulating Vacuum	0.0007	Torr
PAB_S1.PT_181_V_REAL.F_CV	Mole Sieve Cryostat Insulating Vacuum	0.0545	Torr
PAB_S1.TE_216_AR_REAL_C.F_CV	Molecular Sieve Internal Temperature C (F_CV)	265.1	deg C

8:04:44 AM Last 24 Hours 8:04:44 AM