CRYO SYSTEM

FLARE HISTORICAL DATA - MOLECULAR SIEVE REGENERATION

Back to Menu

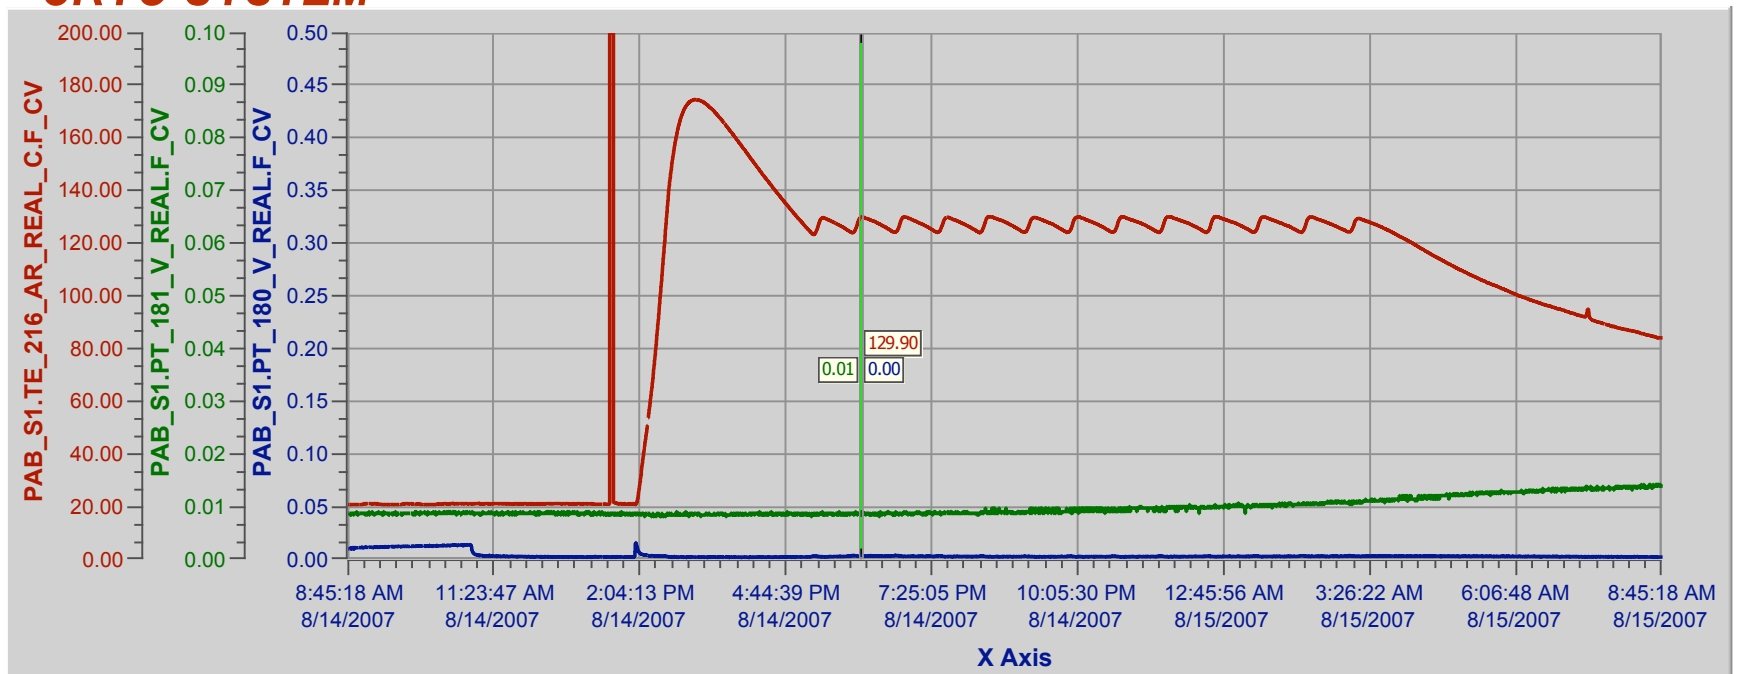

Pen Name	Description	Value	Eng Units
PAB_S1.PT_180_V_REAL.F_CV	Mole Sieve Filter Insulating Vacuum	0.0022	Torr
PAB_S1.PT_181_V_REAL.F_CV	Mole Sieve Cryostat Insulating Vacuum	0.0089	Torr
PAB_S1.TE_216_AR_REAL_C.F_CV	Molecular Sieve Internal Temperature C (F_CV)	129.9	deg C

8:45:18 AM Last 24 Hours 8:45:18 AM

Notes:
Lowered regeneration temperature to 125 C from typical 250 C. This was done with the hope that it would protect the copper conflat gaskets. Large temperature overshoot at the beginning indicates the maximum heater output should be reduced.