CRYO SYSTEM

FLARE HISTORICAL DATA - OXYGEN FILTER REGENERATION

Back to Menu

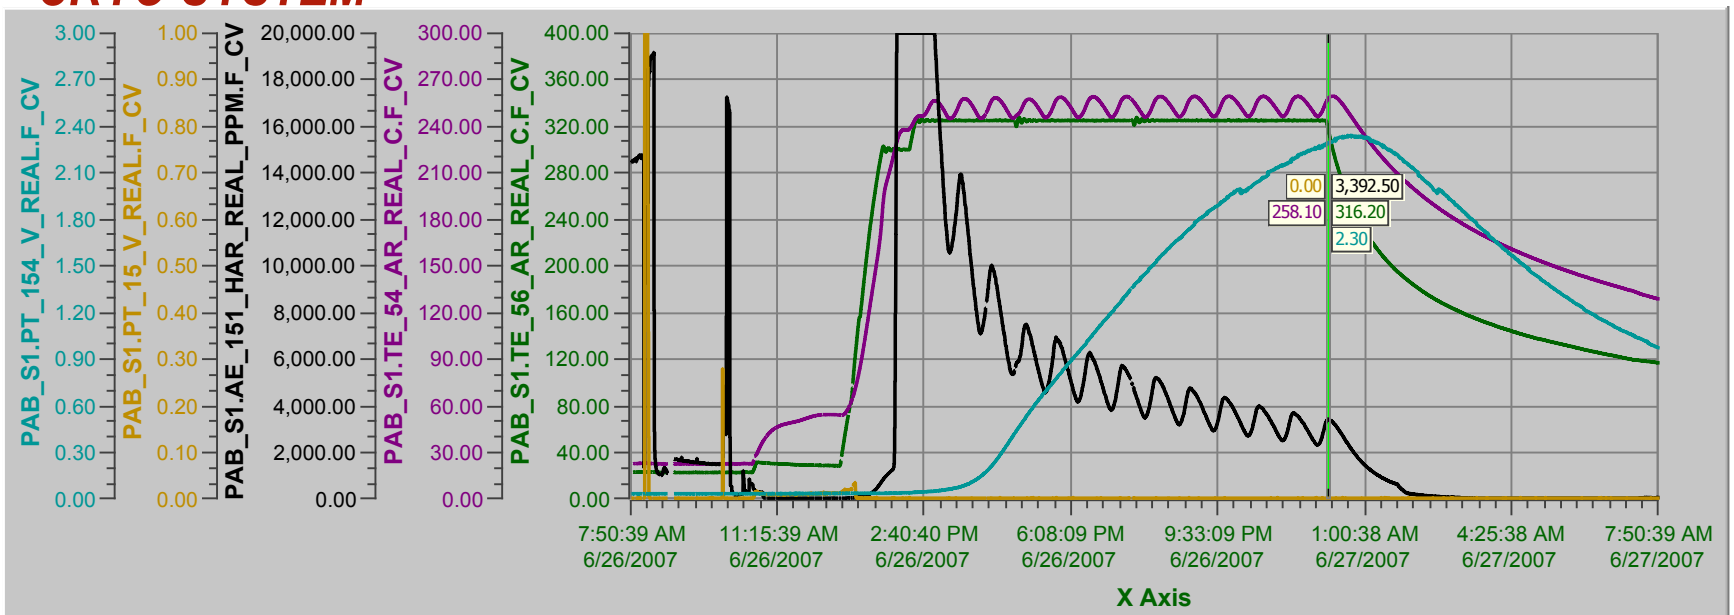

Pen Name	Description	Value	Eng Units
PAB_S1.TE_56_AR_REAL_C.F_CV	O2 filter preheater temperature C (F_CV)	316	C
PAB_S1.TE_54_AR_REAL_C.F_CV	O2 filter internal temperature C (F_CV)	258	C
PAB_S1.AE_151_HAR_REAL_PPM.F_CV	O2 Filter Near Dewpoint Meter ppm (F_CV)	3,392.5	ppm v/v
PAB_S1.PT_15_V_REAL.F_CV	LAr Transfer Line Insulating Vacuum	0.0001	Torr
PAB_S1.PT_154_V_REAL.F_CV	O2 Filter Cryostat Insulating Vacuum	2.2964	Torr

7:50:39 AM | Last 24 Hours | 7:50:39 AM