CRYO SYSTEM

FLARE HISTORICAL DATA - OXYGEN FILTER REGENERATION

Back to Menu

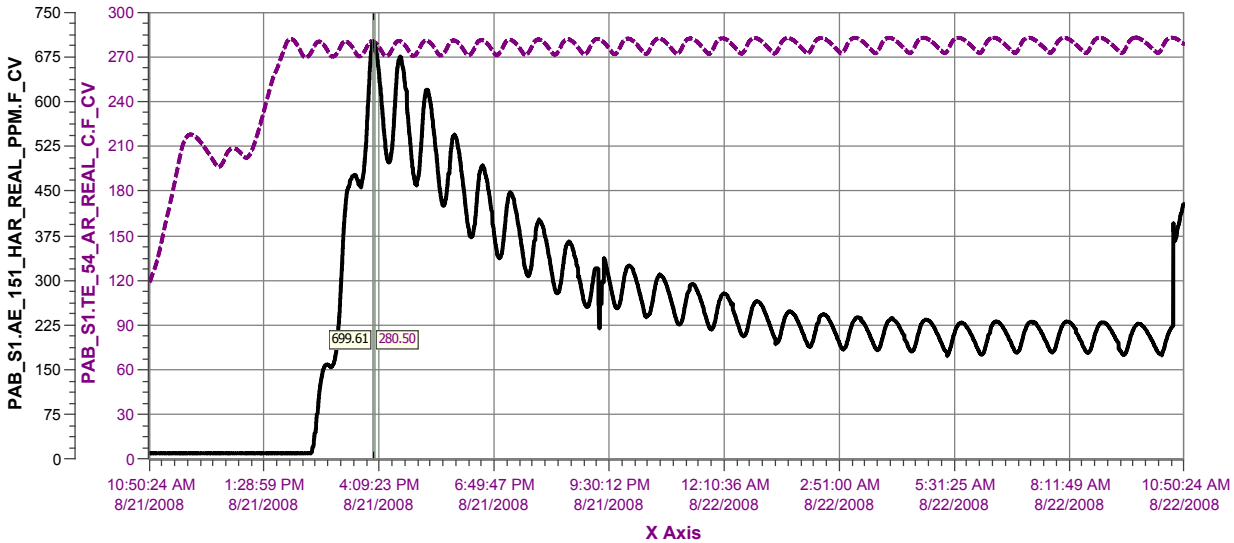

Pen Name	Description	Value	Eng Units	High Over ...	Low Over ...
-- PAB_S1.TE_54_AR_REAL_C.F_...	O2 filter internal temperature C (F_CV)	280.5	C	283.4	118.8
— PAB_S1.AE_151_HAR_REAL_P...	O2 Filter Near Dewpoint Meter ppm (...	700	ppm v/v	702	9

8/21/2008 10:50:24 AM | 24 Hours Ago | Current | 8/22/2008 10:50:24 AM