CRYO SYSTEM

FLARE HISTORICAL DATA - OXYGEN FILTER REGENERATION

Back to Menu

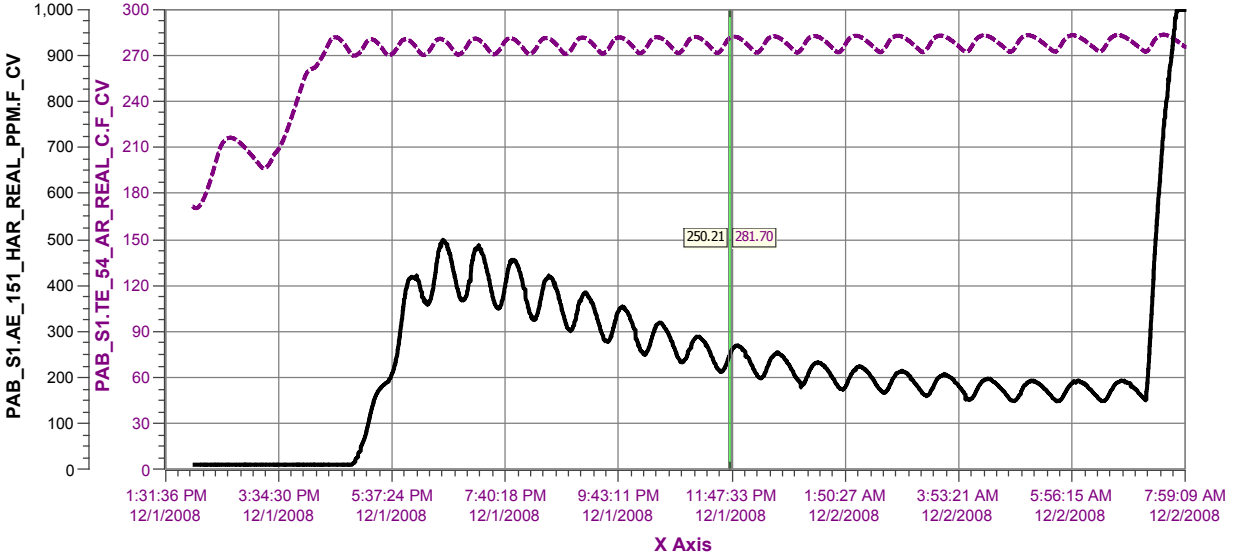

Pen Name	Description	Value	Eng Units	High Over ...	Low Over ...
-- PAB_S1.TE_54_AR_REAL_C.F...	O2 filter internal temperature C (F_C...	281.7	C	283.8	19.7
— PAB_S1.AE_151_HAR_REAL_...	O2 Filter Near Dewpoint Meter ppm ...	250	ppm v/v	3,959	9

12/1/2008 7:59:09 AM | 24 Hours Ago | Current | 12/2/2008 7:59:09 AM