CRYO SYSTEM

FLARE HISTORICAL DATA - OXYGEN FILTER REGENERATION

Back to Menu

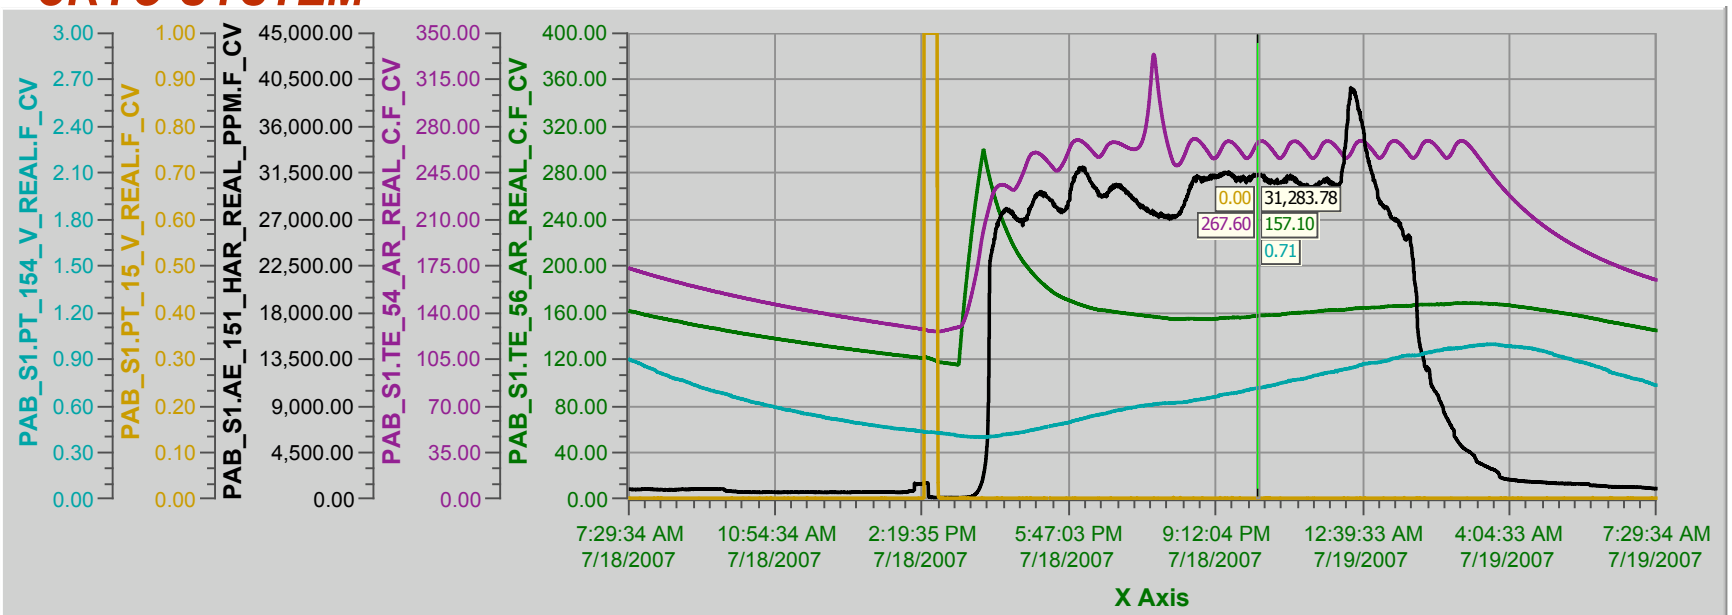

Pen Name	Description	Value	Eng Units	High Over ...
PAB_S1.TE_56_AR_REAL_C.F_CV	O2 filter preheater temperature C (F_CV)	157	C	300
PAB_S1.TE_54_AR_REAL_C.F_CV	O2 filter internal temperature C (F_CV)	268	C	334
PAB_S1.AE_151_HAR_REAL_PPM.F_...	O2 Filter Near Dewpoint Meter ppm (F_CV)	31,283.8	ppm v/v	39,747.6
PAB_S1.PT_15_V_REAL.F_CV	LAr Transfer Line Insulating Vacuum	0.0001	Torr	786.4688
PAB_S1.PT_154_V_REAL.F_CV	O2 Filter Cryostat Insulating Vacuum	0.7116	Torr	0.9944

7:29:34 AM | Last 24 Hours | 7:29:34 AM