SINGLE PASS FILTER REGENERATION

Back to Menu

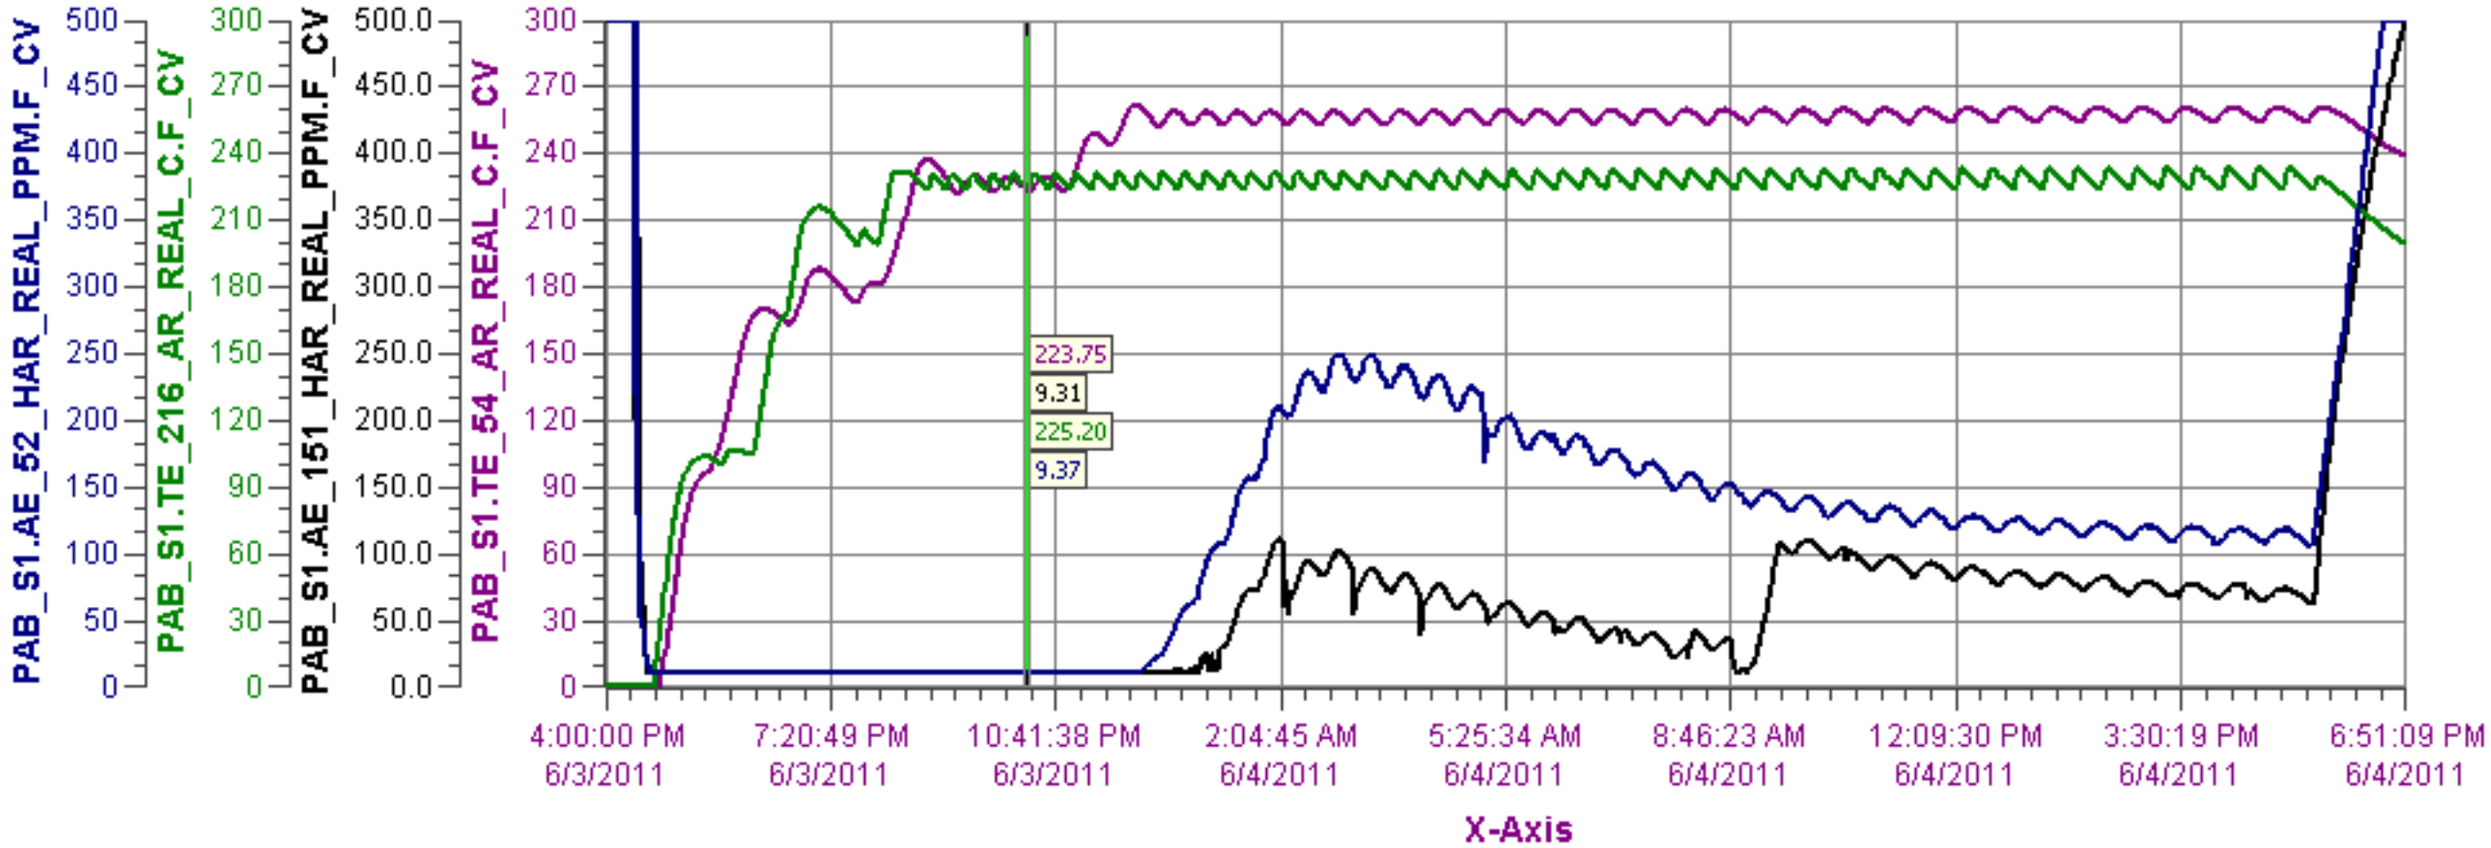

Pen Name	Description	Value	Eng Units	High Over Range	Low Over Range
PAB_S1.TE_54_AR_REAL_...	O2 filter internal temperature C (...	223.8	C	262.0	-27.7
PAB_S1.AE_151_HAR_REA...	O2 Filter Near Dewpoint Meter p...	9.3	ppm v/v	8,587.2	9.2
PAB_S1.TE_216_AR_REAL...	Molecular Sieve Internal Temper...	225.2	deg C	233.5	-33.8
PAB_S1.AE_52_HAR_REAL...	O2 Filter Far Dewpoint Meter ppm	9.4	ppm v/v	10,990.6	9.4

6/3/2011 4:00:00 PM

6/4/2011 6:51:09 PM